


**NOTE:** This diagram shows only one possible, preliminary layout of well rehabilitation equipment. The final layout will be performed by the well rehabilitation contractor and will depend on the types of equipment that will be used by that contractor. Security fencing and traffic control measures will be needed during execution of the work.

Discharge line will consist of firehose during mechanical development and 10-inch (max) aluminum pipe during pumping development. The discharge pipe will consist of ramped piping in access area.

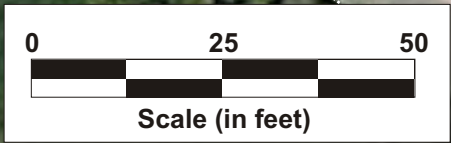

**RCS**  
 RICHARD C. SLADE & ASSOCIATES LLC  
 CONSULTING GROUNDWATER GEOLOGISTS  
 12750 Ventura Blvd., Suite 202  
 Studio City, CA 91604  
 Studio City Phone (818) 506-0418  
 Napa Phone (707) 963-3914  
 Fax (818) 506-1343

**PRELIMINARY SITE LAYOUT DIAGRAM FOR  
 WELL REHABILITATION  
 IRWD DYER RD WELLFIELD WELL 2**  
 Job No. 382-OGE14 June 2013